


Executive Order G-70-183

Exhibit 2

Figure 2A-5

Typical Installation of the
Healy Model 600 Phase I Vapor Recovery System
with Franklin Electric VP-1000 Vapor Pump

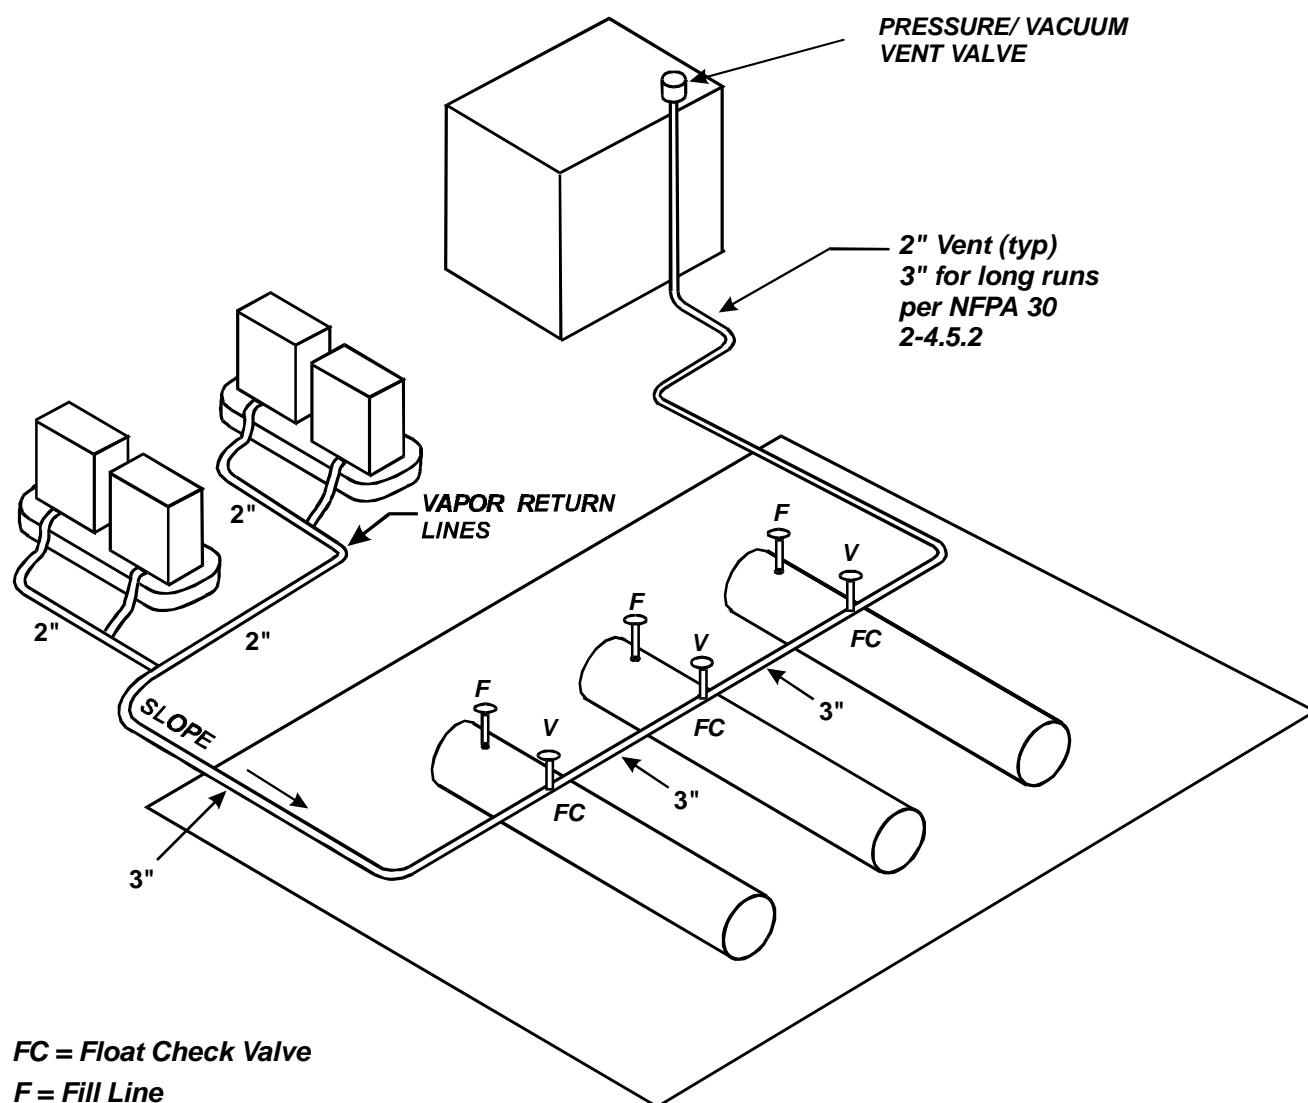

FC = Float Check Valve

F = Fill Line

V = Phase I Vapor Recovery

Note: 1. All Vapor/Vent Lines are 3" Nominal ID Minimum Except as Noted

2. Slope: 1/8" per foot Min.

1/4" per Foot Preferred

**3. Maintain 2'0" Clearance Between Fill Line and
Phase I Vapor Return Line to Delivery Truck**